


NOTES:

- 1 - THIS DETAIL APPLIES TO 1 PLY, NON-GIRDER ROOF TRUSSES BUILT WITHOUT AN OVERHANG, AND NOT FOR TRUSSES WITH A BROKEN OVERHANG.
- 2 - THIS DETAIL APPLIES TO PART 9 TRUSSES MEETING NBCC 2005 AND NBCC 2010 REQUIREMENTS .
- 3 - NAIL SCAB ON ONE SIDE OF THE TRUSS WITH EITHER 0.120" X 3.25" , 0.122" X 3.00" OR 0.144" X 3.0" NAILS AS PER THE NAILING PATTERN PROVIDED ON THIS PAGE. INSTALL NAILS FROM THE SCAB FACE.
- 4 - OVERHANG LENGTH NOT TO EXCEED 24" AND SCAB RETURN LENGTH INTO THE TRUSS TO BE A MINIMUM OF TWICE THE OVERHANG LENGTH, BUT NOT LESS THAN 24".
- 5 - DETAIL APPLIES TO END BEARING CONDITIONS ONLY (NO CANTILEVERS).
- 6 - THIS DETAIL SHALL BE USED ONLY IN CONJUNCTION WITH SEALED MITEK TRUSS DRAWINGS.
- 7 - THE 'MAXIMUM FACTORED BEARING REACTION' BEFORE THE ADDITION OF AN OVERHANG MUST BE AT LEAST 400 LBS LESS THAN THE 'MAXIMUM BEARING CAPACITIES' SHOWN IN DETAILS B37019Q1, B37019Q2, AND B37019Q3.
- 8 - THIS DETAIL IS NOT VALID AFTER APRIL 30, 2013



+ NAIL FROM THE SCAB FACE

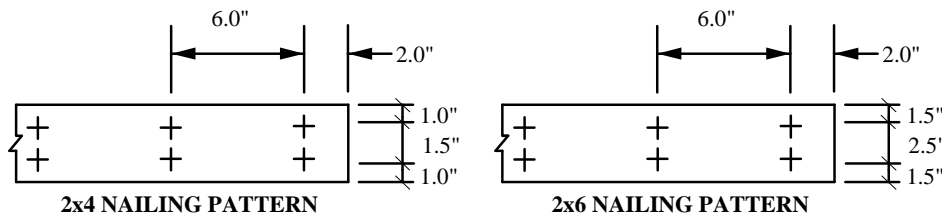

April 23, 2012



MiTek Canada, Inc.
100 Industrial Rd.
Bradford, Ontario, L3Z 3G7